


GROUP NO.	RATINGS						DIMENSIONS IN INCHES MILLIMETERS SHOWN IN ( )							WEIGHT/POLE (INCL. INSUL.)	
	kV NOM.	kV MAX.	kV BIL	AMPS	kA MOM.	CRITICAL FLASH OVER VALUE	"A"	"B"	"C"	"D"	"E"	"F"	"R"	LBS	KG.
	G01	69	72.5	350	1200	61	435kV (pos)	50.4 (1280)	37.60 (955)	45.25 (1149)	17.00 (431)	27.25 (692)	6.4 (163)	34.75 (883)	54
G02	115	123	550	1200	61	672kV (pos)	64.6 (1641)	53.00 (1346)	60.63 (1540)	30.18 (766)	42.38 (1076)	5.8 (147)	50.25 (1276)	64	(29.0)
G03	138	145	650	1200	61	813kV (pos)	75.2 (1910)	62.20 (1580)	69.83 (1774)	39.31 (998)	51.62 (1311)	6.5 (165)	59.50 (1511)	70	(31.8)
G04	161	170	750	1200	61	937kV (pos)	83.5 (2121)	70.40 (1788)	78.00 (1981)	47.62 (1209)	60.63 (1540)	6.55 (166)	67.65 (1718)	81	(36.7)

MAX. WORKING LOAD- 25,000 LBS ALL RATINGS

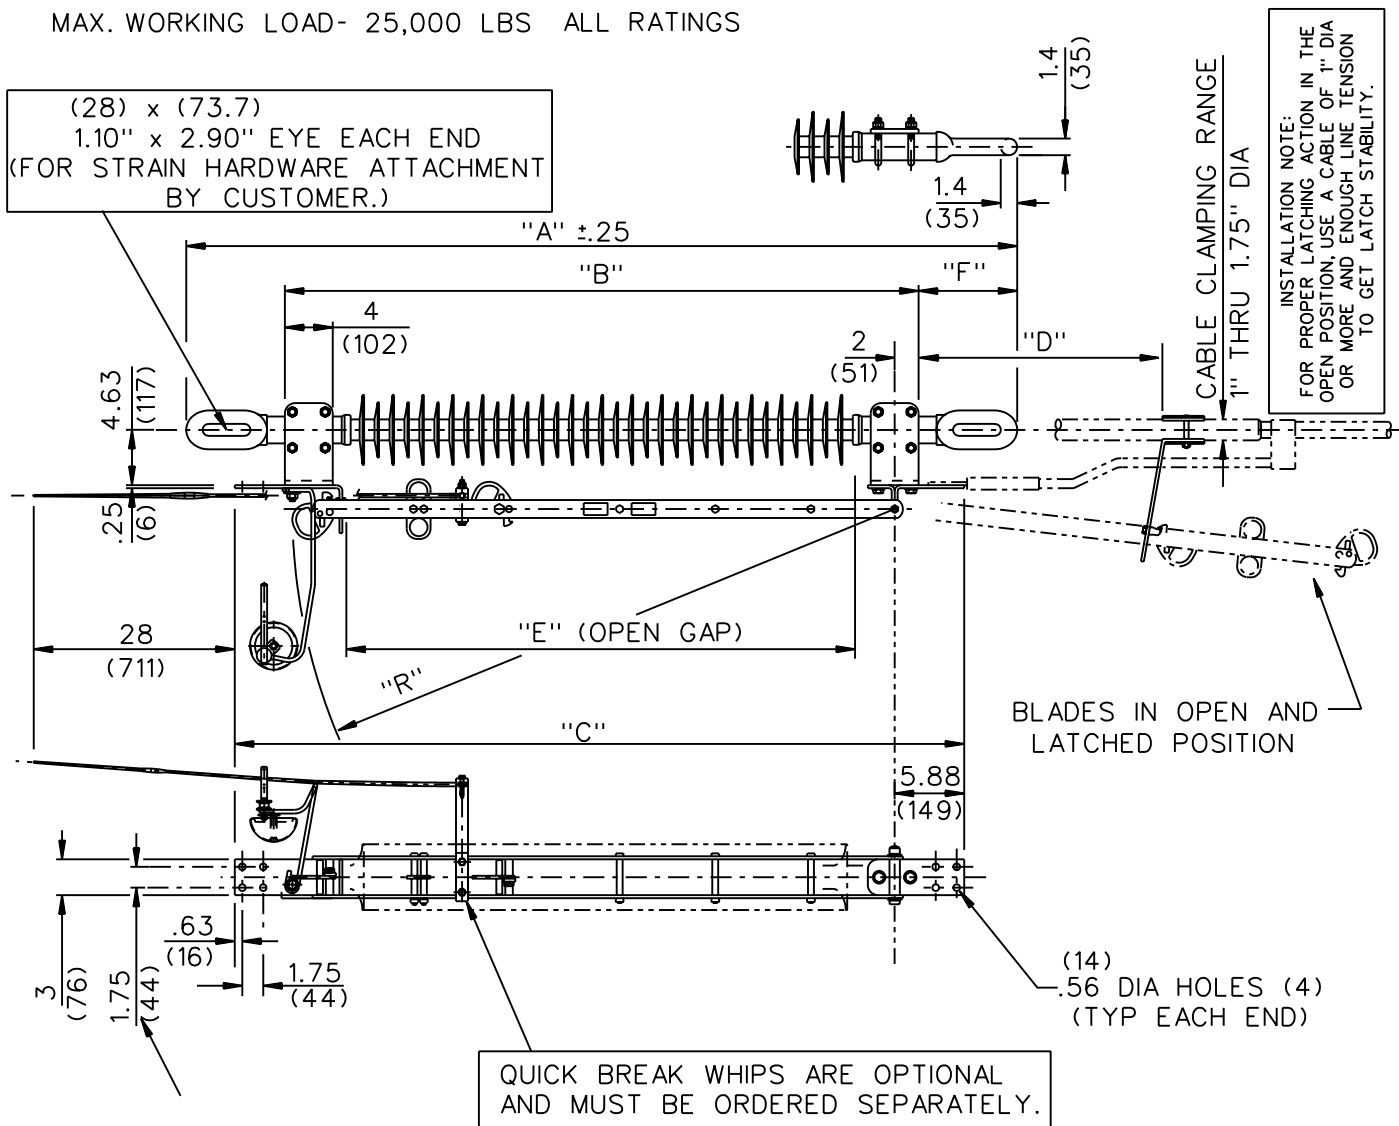

INSTALLATION NOTE:  
FOR PROPER LATCHING ACTION IN THE OPEN POSITION, USE A CABLE OF 1" DIA OR MORE AND ENOUGH LINE TENSION TO GET LATCH STABILITY.

QUICK BREAK WHIPS ARE OPTIONAL AND MUST BE ORDERED SEPARATELY.

- NOTES:
1. ALL DIMENSIONS ARE IN INCHES.
  2. DIMENSIONS IN ( ) ARE IN MM.
  3. WEIGHTS IN ( ) ARE IN KG.

CODE  
A  
00

**Cleaveland / Price Inc.** 1400 RT. 993 Trafford, PA 15085-9550

DISTRIB. CFC DATE 7/18/2009 REV. -

**ILO-C COPPER IN-LINE DISCONNECT SWITCH HOOKSTICK OPERATED  
69kV-161kV, 1200 AMPS, 61kA MOMENTARY NGK INSULATORS**

DRAWN JPB  
CHECKED LAG

DRAWING No. **C02A520**