


GROUP NO.	RATINGS					POST INSUL NEMA TR#	DIMENSIONS IN INCHES <i>MILLIMETERS SHOWN IN ITALICS</i>						WEIGHT/POLE (INCL. INSULS)	
	AMPS	kA MOM.	kV NOM.	kV MAX.	kV BIL		"A"	"B"	"C"	"D"	"E"	"F"	LBS	KG
G01	2500	100	7.2	8.3	95	222	22.78 <i>579</i>	10 <i>254</i>	45 <i>1143</i>	17 <i>432</i>	7 <i>178</i>	47.53 <i>1207</i>	397	<i>180.2</i>
G02			14.4	15.5	110	225	24.78 <i>629</i>	12 <i>305</i>	45 <i>1143</i>	17 <i>432</i>	10 <i>254</i>	49.53 <i>1258</i>	412	<i>187.0</i>
*G03			23	27	150	227	27.78 <i>706</i>	15 <i>381</i>	55 <i>1397</i>	27 <i>686</i>	12 <i>305</i>	62.53 <i>1588</i>	506	<i>229.7</i>
*G04			34.5	38	200	231	32.78 <i>833</i>	20 <i>508</i>	55 <i>1397</i>	27 <i>686</i>	18 <i>457</i>	67.53 <i>1715</i>	580	<i>263.3</i>
*G05			46	48.3	250	267	36.78 <i>934</i>	24 <i>610</i>	60 <i>1524</i>	32 <i>813</i>	22 <i>559</i>	76.53 <i>1944</i>	640	<i>290.6</i>
*G06			69	72.5	350	278	42.78 <i>1087</i>	30 <i>762</i>	70 <i>1778</i>	42 <i>1067</i>	32 <i>813</i>	92.53 <i>2350</i>	815	<i>370.0</i>
G07	3000	120	7.2	8.3	95	222	23.03 <i>585</i>	10 <i>254</i>	45 <i>1143</i>	17 <i>432</i>	7 <i>178</i>	47.78 <i>1214</i>	407	<i>184.7</i>
G08			14.4	15.5	110	225	25.03 <i>636</i>	12 <i>305</i>	45 <i>1143</i>	17 <i>432</i>	10 <i>254</i>	49.78 <i>1264</i>	422	<i>191.6</i>
*G09			23	27	150	227	28.03 <i>712</i>	15 <i>381</i>	55 <i>1397</i>	27 <i>686</i>	12 <i>305</i>	62.78 <i>1595</i>	516	<i>234.3</i>
* G10			34.5	38	200	231	33.03 <i>839</i>	20 <i>508</i>	55 <i>1397</i>	27 <i>686</i>	18 <i>457</i>	67.78 <i>1722</i>	590	<i>267.9</i>
* G11			46	48.3	250	267	37.03 <i>941</i>	24 <i>610</i>	60 <i>1524</i>	32 <i>813</i>	22 <i>559</i>	76.78 <i>1950</i>	650	<i>295.1</i>
* G12			69	72.5	350	278	43.03 <i>1093</i>	30 <i>762</i>	70 <i>1778</i>	42 <i>1067</i>	32 <i>813</i>	92.78 <i>2357</i>	825	<i>374.6</i>

SWITCHES WITH AN
ASTERISK (*) ARE
COUNTERBALANCED

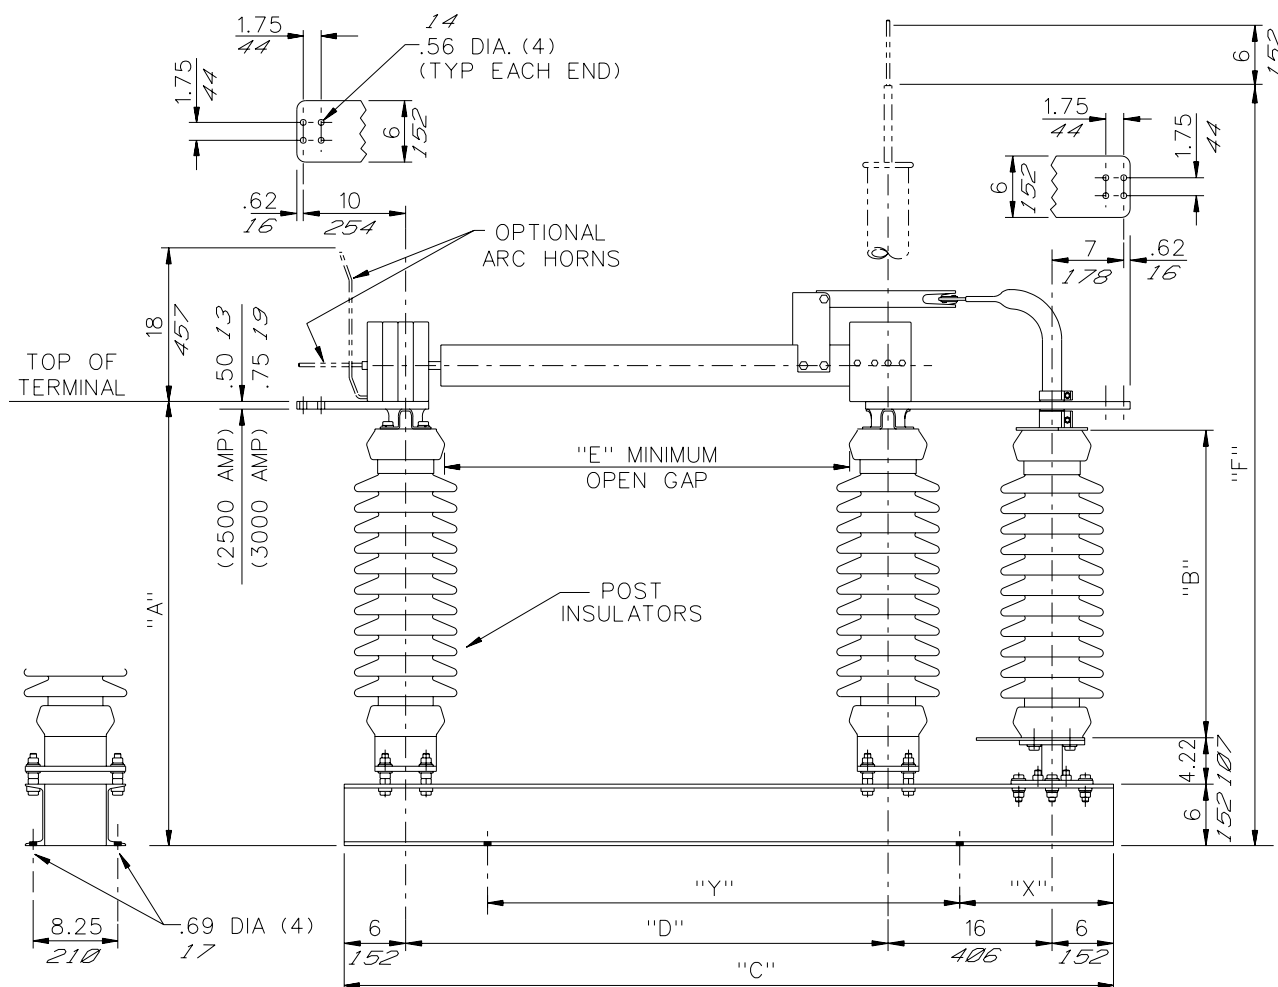

NOTES:

1. INSULATORS INVERTED FOR UNDERHUNG MOUNTING.
2. ALL DIMENSIONS ARE IN INCHES.
3. DIMENSIONS IN *ITALICS* ARE IN *MM*
4. WEIGHTS IN *ITALICS* ARE IN *KG*
5. CUSTOMER TO SPECIFY "X" AND "Y" DIMENSIONS

CODE
A
00

Cleaveland / Price Inc. 14000 RT. 993 Trafford, PA 15085-9550

DATE
05-27-97

REV.
A

V2-C COPPER VERTICAL BREAK DISCONNECT SWITCH
7.2kV-69kV; 2500A-3000A; WITH 5" B.C. INSULATORS

DRAWN
GH
CHECKED
SF

DRAWING No.
C06A037