


GROUP NO.	RATINGS					POST INSUL NEMA TR*	DIMENSIONS IN INCHES MILLIMETERS SHOWN IN ()							WEIGHT/POLE (INCL. INSUL.)	
	kV NOM.	kV MAX.	kV BIL	AMPS	kA MOM.		"A"	"B"	"C"	"D"	"E"	"R ₁ "	"R ₂ "	LBS	kg
G01	230	245	900	3000	120	304	101.85 (2587)	80.00 (2032)	113.00 (2870)	96.00 (2438)	84.00 (2134)	54.80 (1392)	50.81 (1291)	1298	(589)
G02	230	245	1050			312	113.85 (2829)	92.00 (2337)	131.00 (3327)	114.00 (2896)	104.00 (2642)	63.80 (1621)	59.81 (1519)	1468	(666)

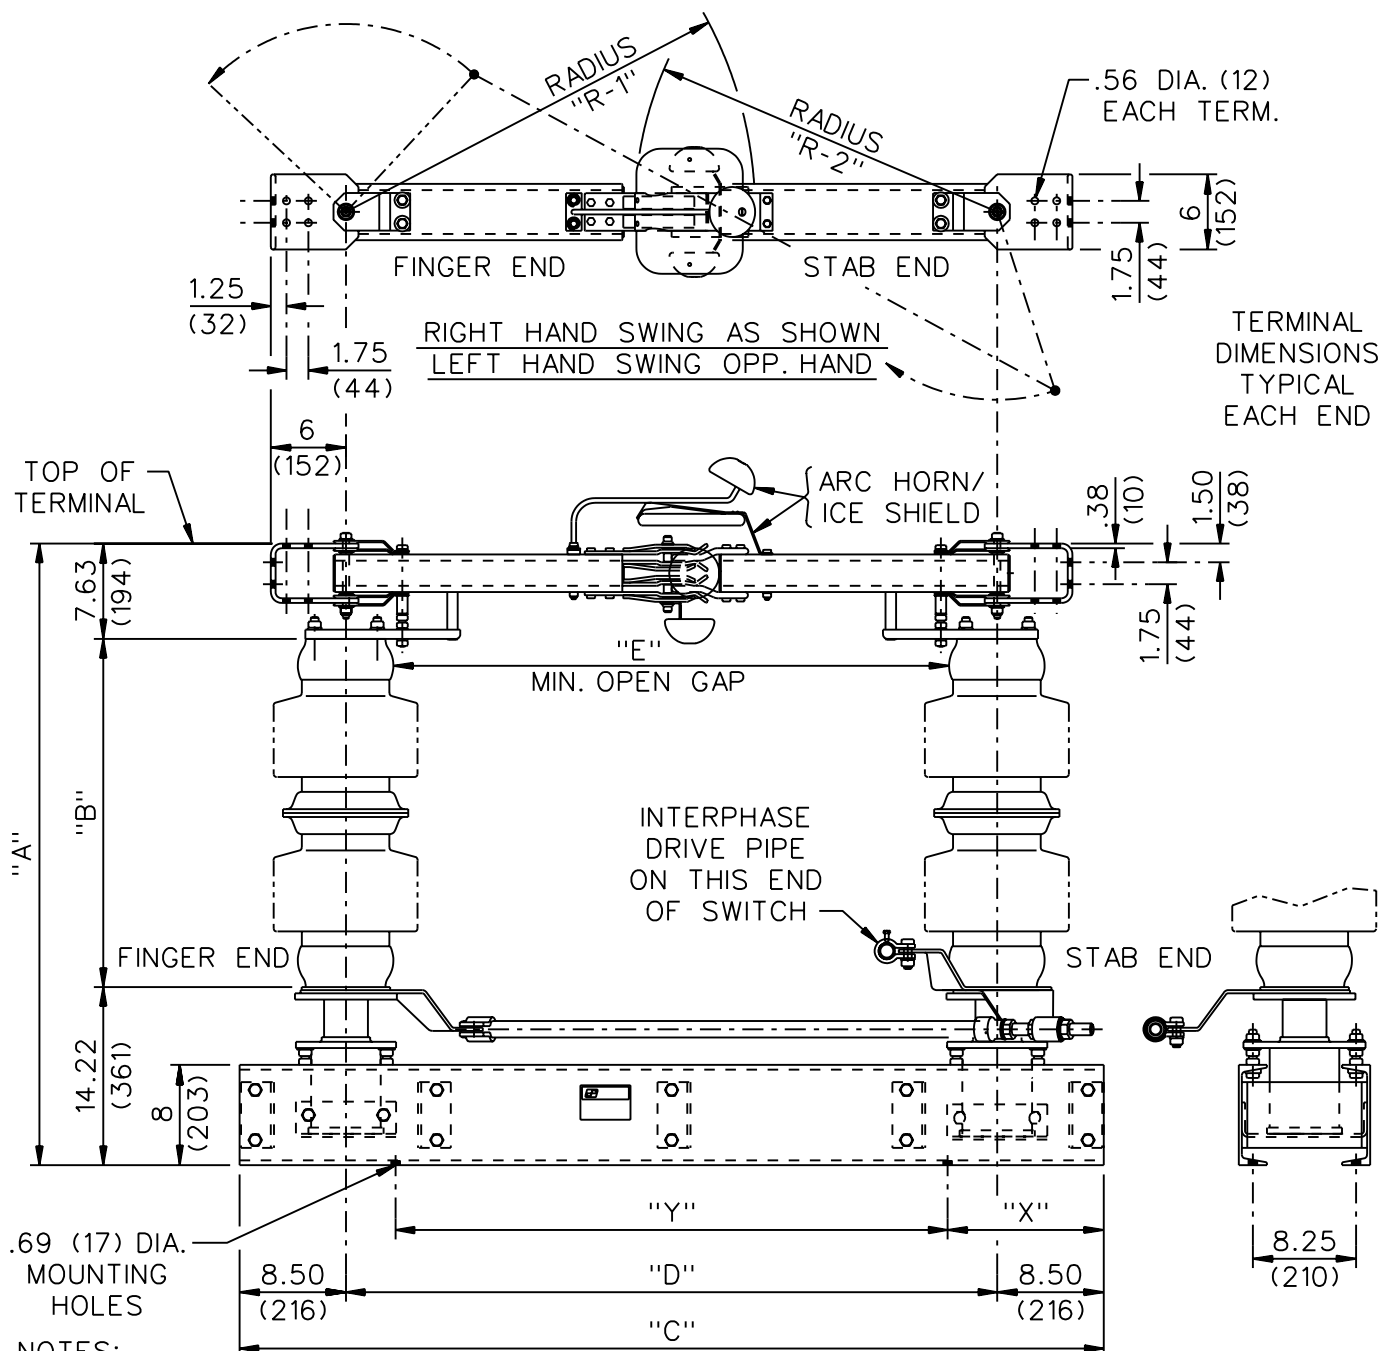

Cleaveland / Price Inc. 14000 RT. 993 Trafford, PA 15085-9550

DISTRIB. 001 DATE 09/28/2001

CODE
A
00

**CB-A ALUMINUM CENTER BREAK DISCONNECT SWITCH
230kV, 3000A, WITH 5" B.C. INSULATORS**

DRAWN
LAB
CHECKED
DP

DRAWING No.

C26A027