


GROUP NO.	RATINGS					POST INSUL NEMA TR*	DIMENSIONS IN INCHES MILLIMETERS SHOWN IN ()						WEIGHT/POLE (INCL. INSUL.)	
	kV NOM.	kV MAX.	kV BIL	AMPS	KA MOM.		"A"	"B"	"C"	"E"	"R ₁ "	"R ₂ "	LBS	kg
G01	14.4	15.5	110	2000	100	205	21.78 (553)	10.00 (254)	36.42 (925)	10.00 (254)	16.67 (423)	13.29 (338)	143	(65)
G02	23	27	150			208	25.41 (645)	14.00 (356)	39.80 (1011)	12.00 (305)	18.36 (466)	14.98 (380)	165	(75)
G03	34.5	38	200			210	29.03 (737)	18.00 (457)	43.18 (1097)	18.00 (457)	20.04 (509)	16.68 (424)	189	(86)
G04	46	48.3	250			214	32.66 (830)	22.00 (559)	46.57 (1183)	22.00 (559)	21.73 (552)	18.36 (466)	234	(106)
G05	69	72.5	350			216	39.91 (1014)	30.00 (762)	53.33 (1355)	32.00 (813)	25.12 (638)	21.75 (552)	282	(128)

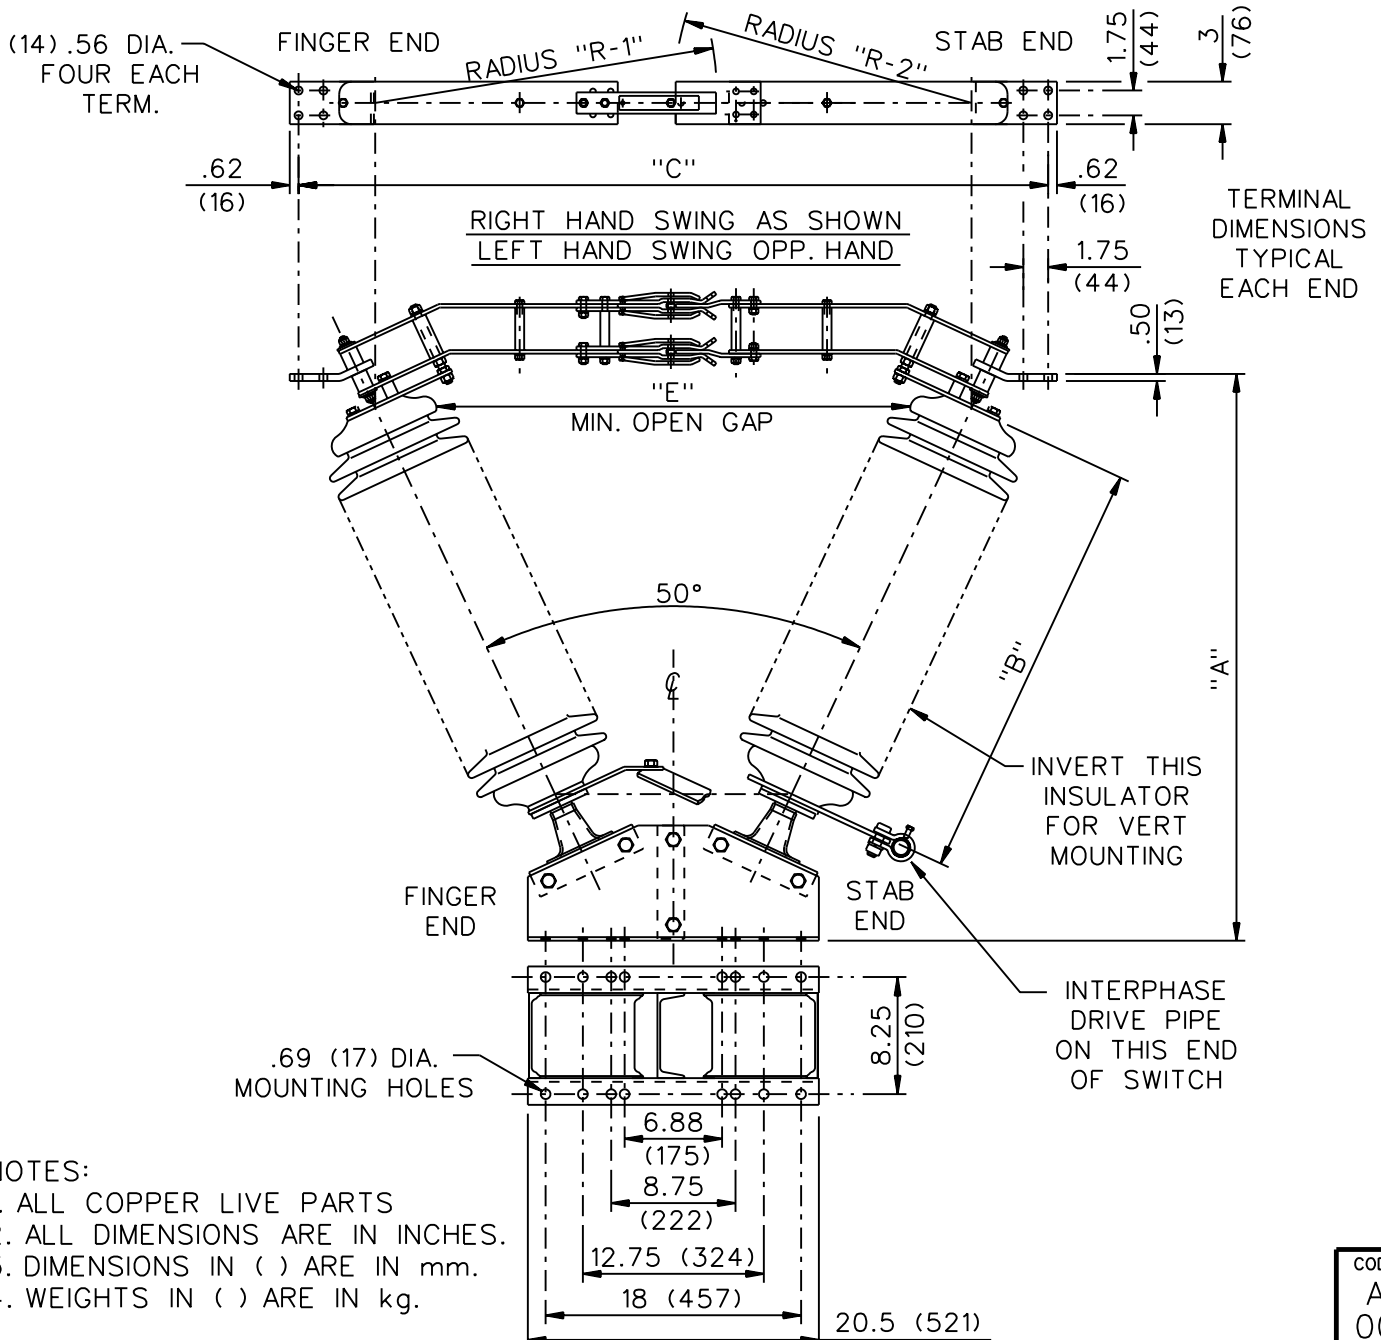

Cleaveland / Price Inc. 14000 RT. 993 Trafford, PA 15085-9550

DISTRIB. 001

DATE 11-12-02

CODE
A
00

REV. D

CB-CV COPPER CENTER BREAK DISCONNECT SWITCH
15kV, THRU 69kV, 2000A WITH 3" B.C. INSULATORS

DRAWN
GH
CHECKED
SF

DRAWING No.

C26A039