


GROUP NO.	RATINGS					POST INSUL NEMA TR#	DIMENSIONS IN INCHES MILLIMETERS SHOWN IN []						WEIGHT/POLE (INCL. INSUL.)	
	kV NOM.	kV MAX.	kV BIL	AMPS	kA MOM.		"A"	"B"	"C"	"E"	"R ₁ "	"R ₂ "	LBS	kg
G01	14.4	15.5	110	1200	61	205	21.78 [553]	10.00 [254]	36.42 [925]	10.00 [254]	16.67 [423]	13.29 [338]	135	[26]
G02	23	27	150			208	25.41 [645]	14.00 [356]	39.80 [1011]	12.00 [305]	18.36 [466]	14.98 [380]	156	[71]
G03	34.5	38	200			210	29.03 [737]	18.00 [457]	43.18 [1097]	18.00 [457]	20.04 [509]	16.68 [424]	178	[81]
G04	46	48.3	250			214	32.66 [830]	22.00 [559]	46.57 [1183]	22.00 [559]	21.73 [552]	18.36 [466]	224	[102]
G05	69	72.5	350			216	39.91 [1014]	30.00 [762]	53.33 [1355]	32.00 [813]	25.12 [638]	21.75 [552]	270	[122]

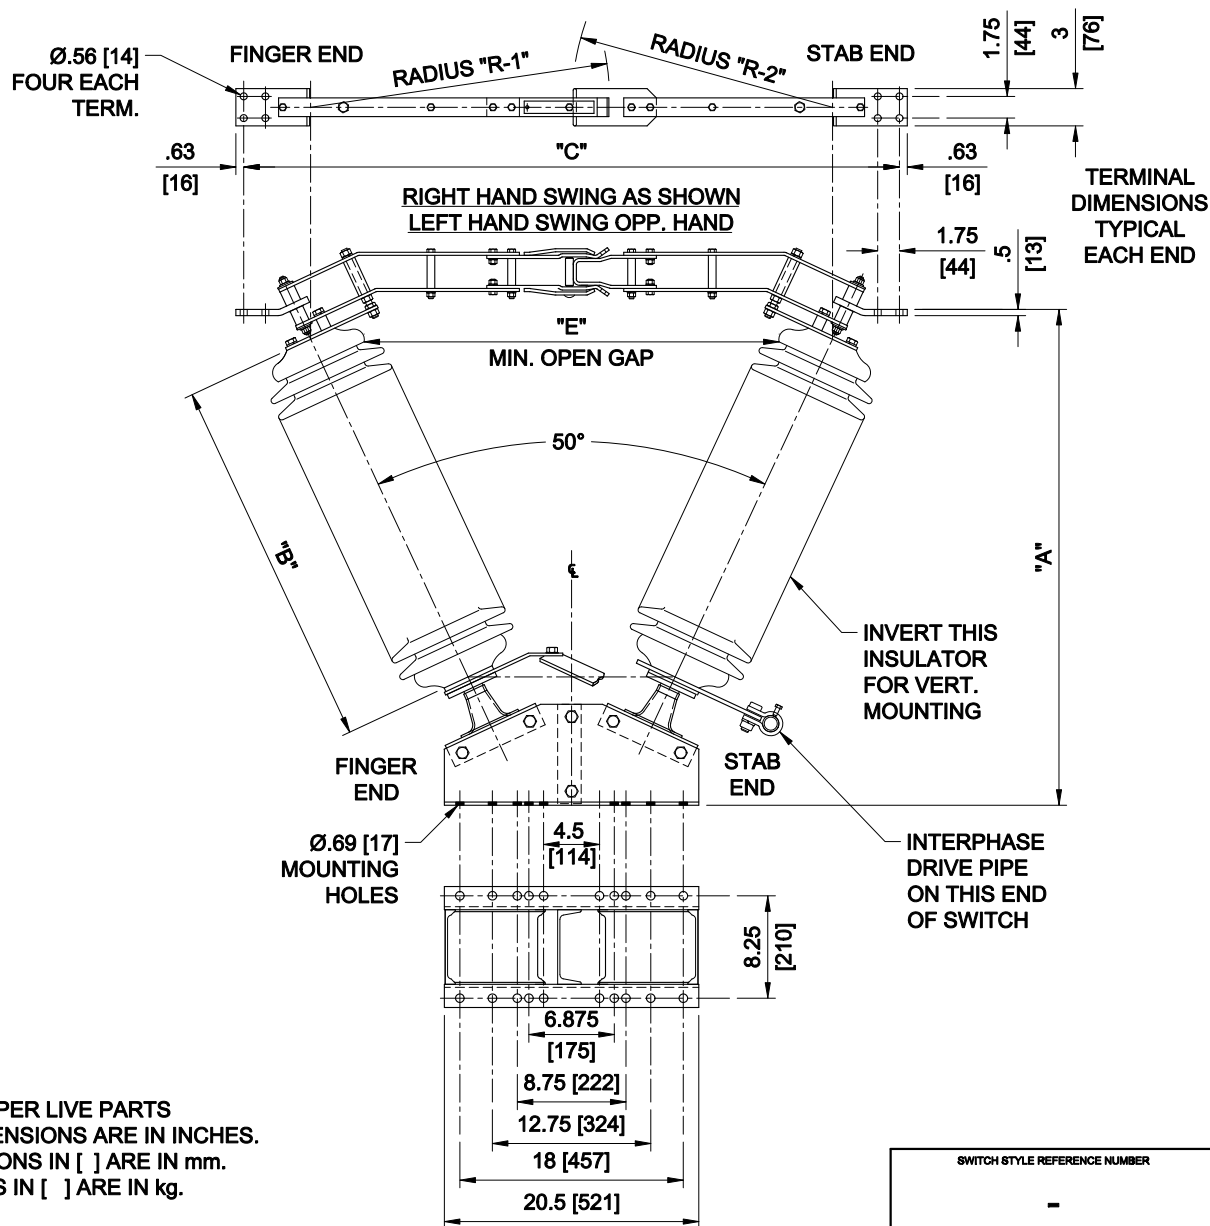

Cleaveland/Price Inc. 14000 Rt. 993 Trafford, PA 15085-9550

**CB-CV COPPER CENTER BREAK DISC SWITCH
15-69kV 1200A WITH 3" BC INSULATORS**

SWITCH STYLE REFERENCE NUMBER		REV
-		G
DRAWN	DATE	VERSION
GH	10/30/2002	1
CHECKED	DRAWING NO.	
SF	C26A038	
APPROVED		