



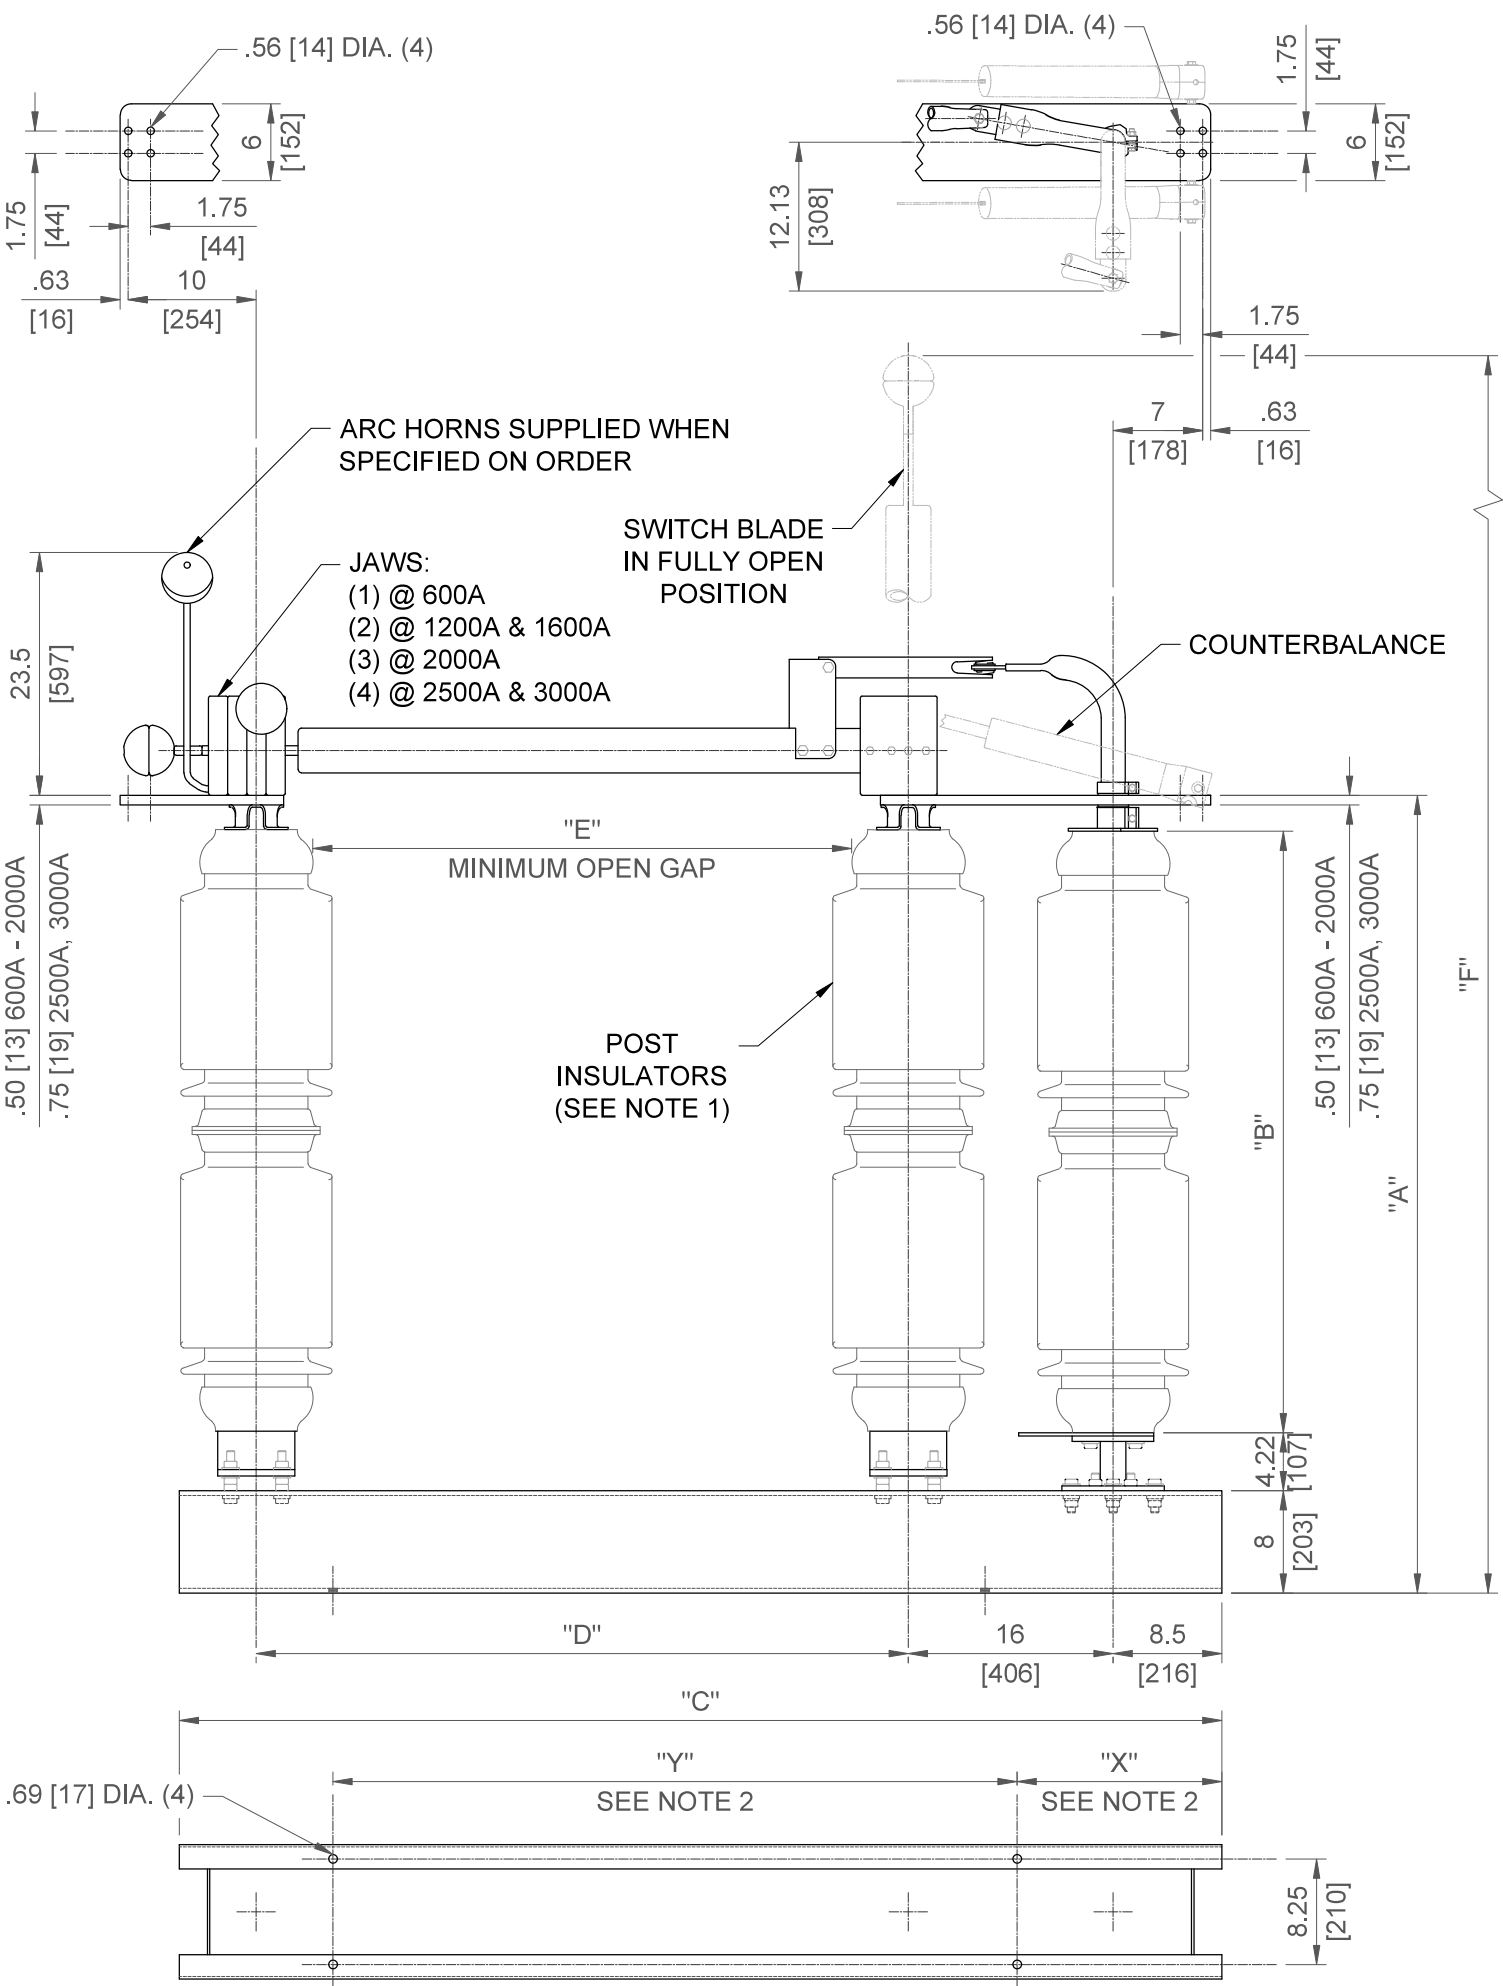

SWITCH STYLE NO.	RATINGS					POST INSUL NEMA TR#	DIMENSIONS IN INCHES MILLIMETERS SHOWN IN []						WEIGHT/POLE (INCL. INSUL.)	
	NOM kV	MAX kV	kV BIL	AMPS	MOM kA		"A"	"B"	"C"	"D"	"E"	"F"	LBS.	kG
C06B037G01	230	245	900	600	40	304	94.78 [2407]	80 [2032]	124.50 [3162]	94 [2388]	84 [2134]	199.41 [5065]	1667 [757]	
C06B037G02				1200	61							1683 [764]		
★ C06B037G03				1600	70							1688 [766]		
★ C06B037G04				2000	100		200.91 [5103]					1570 Ⓐ	[713]	
★ C06B037G05				2500	100		202.66 [5147]					1609 Ⓐ	[730]	
★ C06B037G06				3000	120							1634 Ⓐ	[742]	
C06B037G07	230	245	1050	600	40	312	106.78 [2712]	92 [2337]	144.50 [3670]	114 [2896]	104 [2641]	231.65 [5884]	1751 Ⓐ	[795]
C06B037G08				1200	61								1770 Ⓐ	[804]
★ C06B037G09				1600	70								1773 Ⓐ	[805]
★ C06B037G10				2000	100		233.16 [5922]					1776 Ⓐ	[806]	
★ C06B037G11				2500	100		234.91 [5967]					1815 Ⓐ	[824]	
★ C06B037G12				3000	120							1843 Ⓐ	[837]	

Ⓐ = COPPER TERMINAL PADS WITH ALUMINUM BLADE

- NOTES:
1. INSULATORS INVERTED FOR UNDERHUNG MOUNTING. (SEE NOTE 6)
 2. CUSTOMER TO SUPPLY "X" & "Y" DIMENSIONS.
 3. ALL DIMENSIONS ARE IN INCHES.
 4. DIMENSIONS IN [] ARE IN mm.
 5. WEIGHTS IN [] ARE IN kg.
 6. SWITCH STYLE NUMBERS SHOWN WITH *, ARE NOT AVAILABLE IN UNDERHUNG MOUNTING CONFIGURATION.

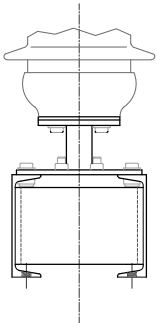

REV D	 Cleaveland/Price Inc. 14000 Route 993 : Trafford, PA 15085				
VERSION 1	DRAWN LAB	CHECKED MJG	APPROVED	DATE 10/02/2001	SWITCH STYLE REFERENCE NUMBER -
V2-C COPPER VERTICAL BREAK DISCONNECT SWITCH 230kV 600-3000A					DWG NO. C06B037