


GROUP NO.	RATINGS						POST INSUL NEMA TR#	DIMENSIONS IN INCHES MILLIMETERS SHOWN IN []						WEIGHT/POLE (INCL. INSUL.)	
	kV NOM.	kV MAX.	kV BIL	AMPS	kA MOM. ASYM.	kA PEAK		"A"	"B"	"C"	"D"	"E"	"F"	LBS	kg
G01 G02	7.2	8.3	95	4000 6000	120	195	222	24.79 [630]	10 [254]	48 [1219]	20 [508]	7 [178]	40.41 [1026]	360	[163.4]
G03 G04	14.4	15.5	110	4000 6000	120	195	225	26.79 [680]	12 [305]	48 [1219]	20 [508]	10 [254]	42.41 [1077]	373	[169.3]
G05 G06	23	27	150	4000 6000	120	195	227	29.79 [757]	15 [381]	56 [1422]	28 [711]	12 [305]	53.41 [1357]	480	[218.0]
G07 G08	34.5	38	200	4000 6000	120	195	231	34.85 [885]	20 [508]	56 [1422]	28 [711]	18 [457]	58.41 [1484]	556	[252.4]

STANDARD HORIZONTAL TERMINAL PAD
WITH (4) .56 [14] HOLES (EACH END)

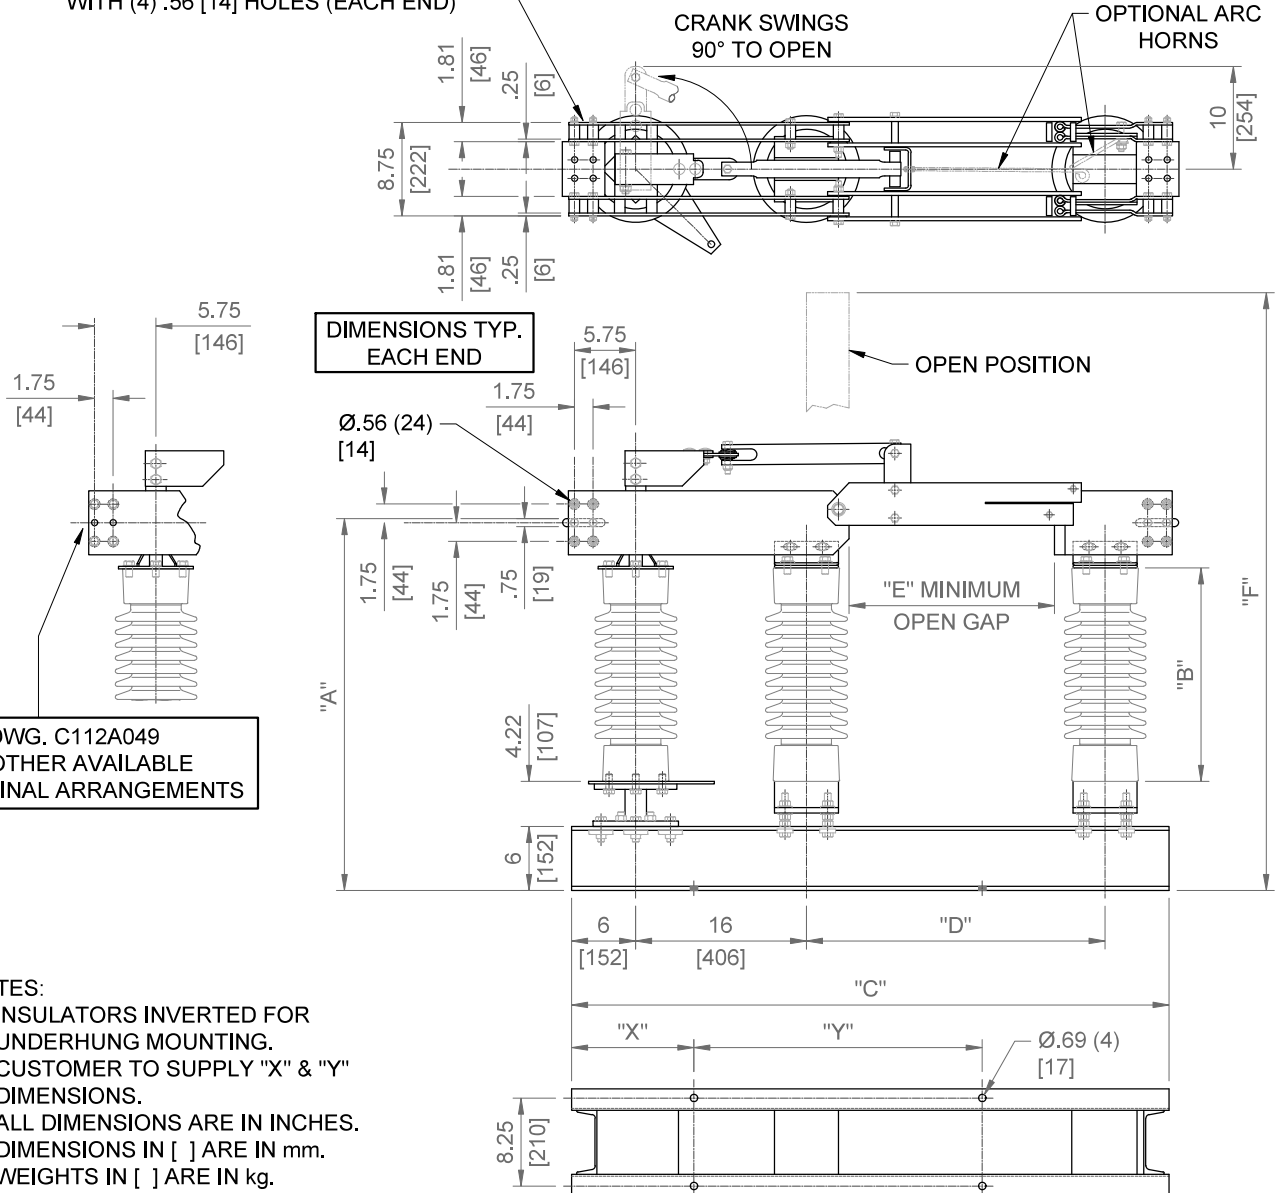

Cleaveland/Price Inc. 14000 Rt. 993 Trafford, PA 15085-9550										SWITCH STYLE REFERENCE NUMBER		REV
										-		M
V2-HC COPPER VERTICAL BREAK DISCONNECT SWITCH 7.2KV-34.5KV 4000 & 6000A, 5" B.C. INSULATORS										DRAWN	DATE	VERSION
										GBN	12/03/1990	2
										CHECKED	DRAWING NO.	
										SF		
										APPROVED	C112A035	