


GROUP NO.	RATINGS					POST INSUL. NEMA TR#	DIMENSIONS IN INCHES MILLIMETERS SHOWN IN []								WEIGHT/POLE (INCL. INSUL.)	
	kV NOM.	kV MAX.	kV BIL	AMPS	kA MOM.		"A"	"B"	"C"	"D"	"E"	"F"	"R1"	"R2"	lbs	Kg
G01	69	72.5	350	1600	70	278	43.04 [1093]	30 [762]	33.21 [844]	25.98 [660]	32 [813]	15 [381]	33.48 [850]	28.68 [728]	474	215
G02	115	123	550			286	56.03 [1423]	45 [1143]	40.71 [1034]	38.97 [990]	50 [1270]	19.3 [490]	42.05 [1068]	37.25 [946]	607	276
G03	138	145	650			288	63.83 [1621]	54 [1372]	45.21 [1148]	46.77 [1188]	60 [1524]	21.9 [556]	47.24 [1200]	42.44 [1078]	677	307
G04	161	170	750			291	70.75 [1797]	62 [1575]	49.21 [1250]	53.69 [1364]	68 [1727]	24.25 [616]	51.8 [1316]	47 [1194]	861	391

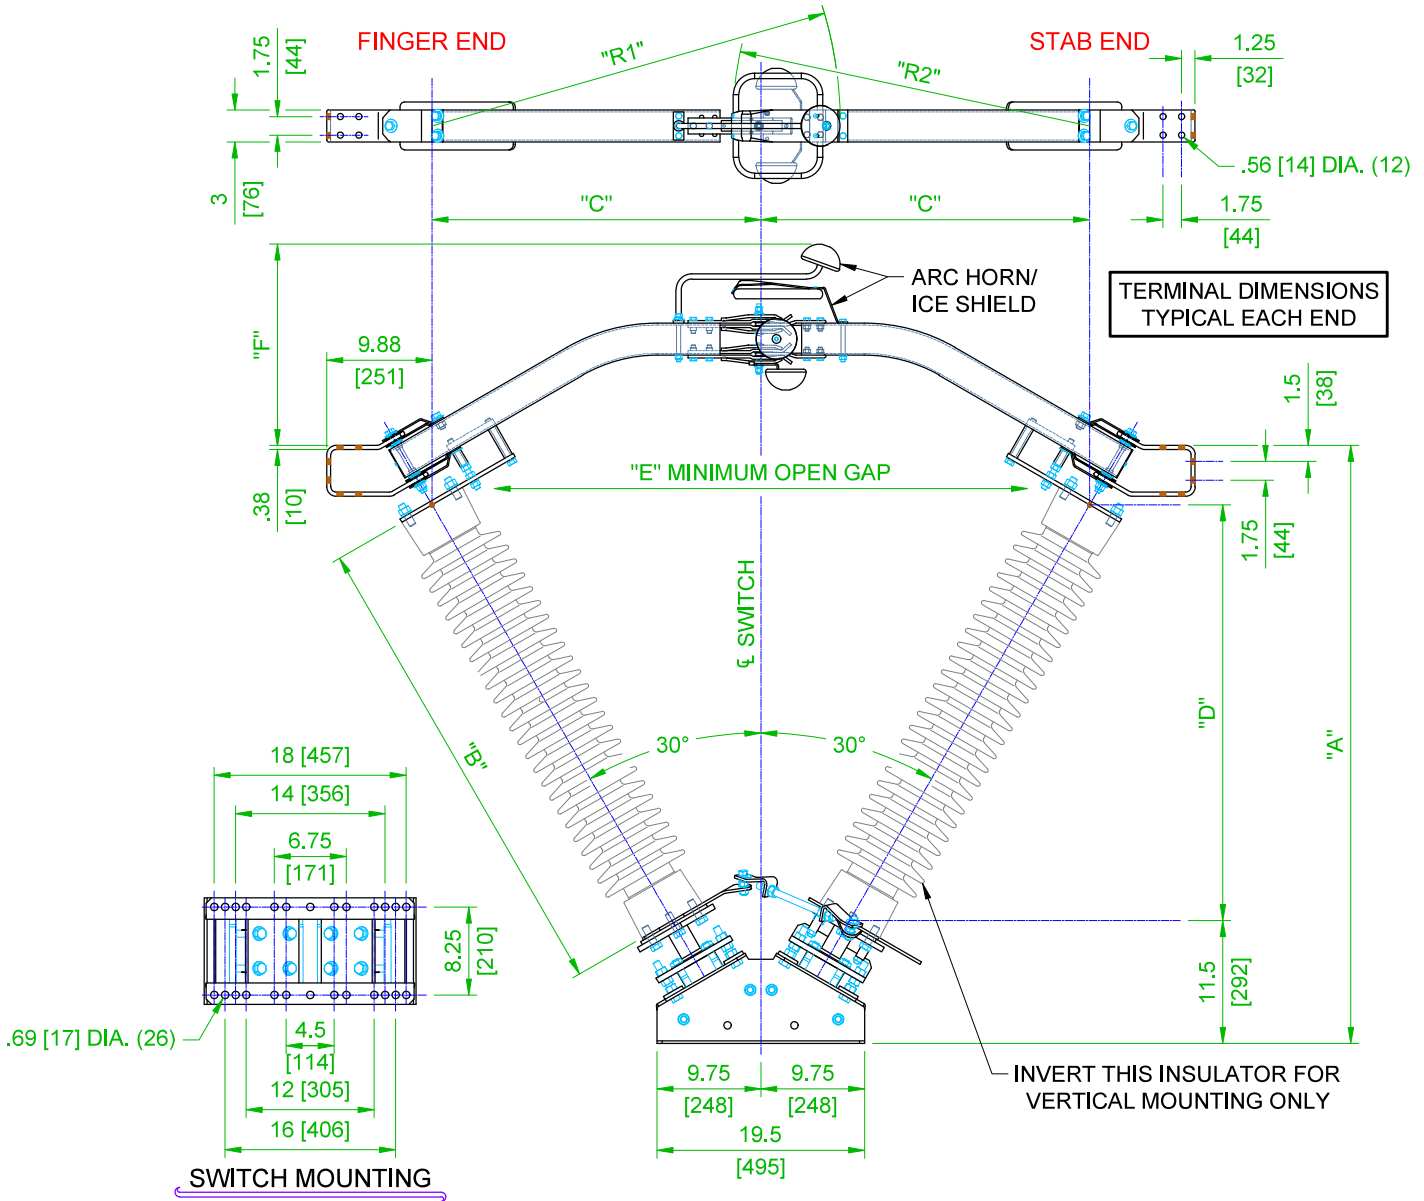

NOTES:

1. ALUMINUM BLADES AND COPPER TERMINALS.
2. C.W. (RIGHT HAND) SWING AS SHOWN. C.C.W. (LEFT HAND) SWING OPPOSITE HAND.
3. INSULATORS INVERTED FOR UNDERHUNG MOUNTING.
4. ALL DIMENSIONS ARE IN INCHES.
5. DIMENSIONS SHOWN IN [] ARE IN MILLIMETERS.

Cleaveland/Price Inc. 14000 Rt. 993 Trafford, PA 15085-9550	SWITCH STYLE REFERENCE NUMBER		REV
	N/A		A
CB-AV ALUMINUM CENTER BREAK VEE DISCONNECT SWITCH 69-161 kV, 1600 A, WITH 5" B.C. INSULATORS	DRAWN	DATE	VERSION
	MES	07/14/2005	1
	CHECKED	DRAWING NO.	
	LAB	C26A022	
	APPROVED		