


GROUP NO.	RATINGS					POST INSUL NEMA TR#	DIMENSIONS IN INCHES MILLIMETERS SHOWN IN ()							WEIGHT/POLE (INCL. INSUL.)	
	kV NOM.	kV MAX.	kV BIL	AMPS	KA MOM.		"A"	"A1"	"B"	"C"	"D"	"E"	"R"	LBS	Kg.
G01	46	48.3	250	600	40	214	26.09 [663]	26.46 [672]	22 [559]	42 [1067]	30 [762]	20 * [508]	32.38 [822]	335	(153)
G02				1200	61									360	(164)
G03				1600	70									385	(176)
G04				2000	70									390	(178)
G05	69	72.5	350	600	40	216	34.09 [866]	34.46 [875]	30 [762]	54 [1372]	42 [1067]	32 [813]	44.38 [1127]	427	(194)
G06				1200	61									450	(205)
G07				1600	70									550	(250)
G08				2000	70									555	(253)

* PASSED DIELECTRIC TEST (LESS THAN ANSI MIN)

NOTES:

1. INSULATORS INVERTED FOR VERTICAL OR UNDERHUNG MOUNTING.
2. ALL DIMENSIONS ARE IN INCHES.
3. DIMENSIONS IN [] ARE IN mm.
4. WEIGHTS IN () ARE IN Kg.

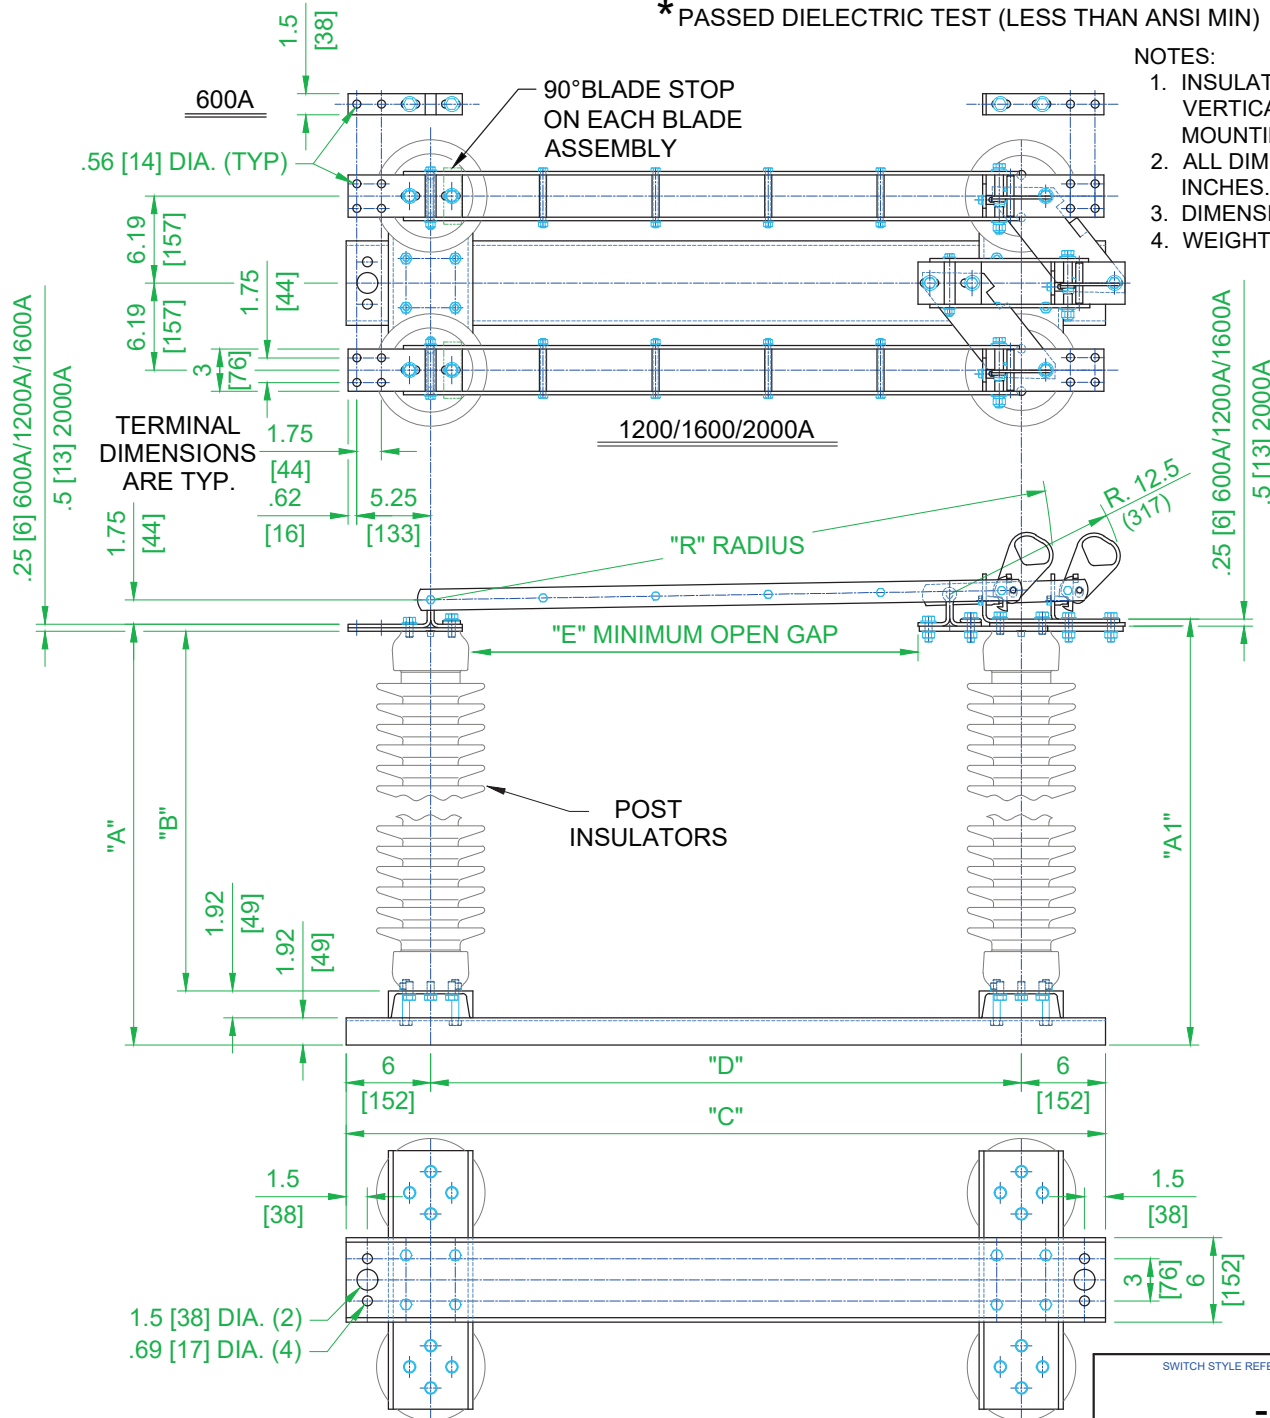

REVISION

SWITCH STYLE REFERENCE NUMBER		REV
-		C
DRAWN	DATE	VERSION
MES	03/31/2003	1
CHECKED	DRAWING NO.	
LAB	C13A058	
APPROVED		

Cleaveland/Price Inc. 14000 Rt. 993 Trafford, PA 15085-9550

RBI COPPER HOOK OPERATED BYPASS SWITCH
46-69kV 600/1200/1600/2000A 3" BC INSUL.
6" CHANNEL BASE