


GROUP NO.	RATINGS					POST INSUL. NEMA TR*	DIMENSIONS IN INCHES MILLIMETES SHOWN IN []						WEIGHT/POLE (INCL. INSUL.)	
	kV NOM.	kV MAX.	kV BIL	AMPS	kA MOM.		"A"	"B"	"C"	"D"	"E"	"R"		
G01	7.2	8.3	95	3000	100	202	20.13 [511]	7.5 [191]	35	23	7 [178]	22.875	215	[98]
G02	14.4	15.5	110			205	22.63 [575]	10 [254]	[889]	[584]	12 [305]	[581]	230	[104]
G03	23	27	150			208	26.63 [676]	14 [356]	41	29	15 [381]	28.75	270	[122]
G04	34.5	38	200			210	30.63 [778]	18 [457]	[1041]	[737]	18 [457]	[730]	290	[132]

NOTES:

1. INSULATORS INVERTED FOR UNDERHUNG MOUNTING.
2. CUSTOMER TO SUPPLY "X" & "Y" DIMENSIONS
3. ALL DIMENSIONS ARE IN INCHES.
4. DIMENSIONS IN [] ARE IN MM.
5. WEIGHTS IN [] ARE IN KG.

TYPICAL TERMINAL DIMS.
FOR BOTH SIDES

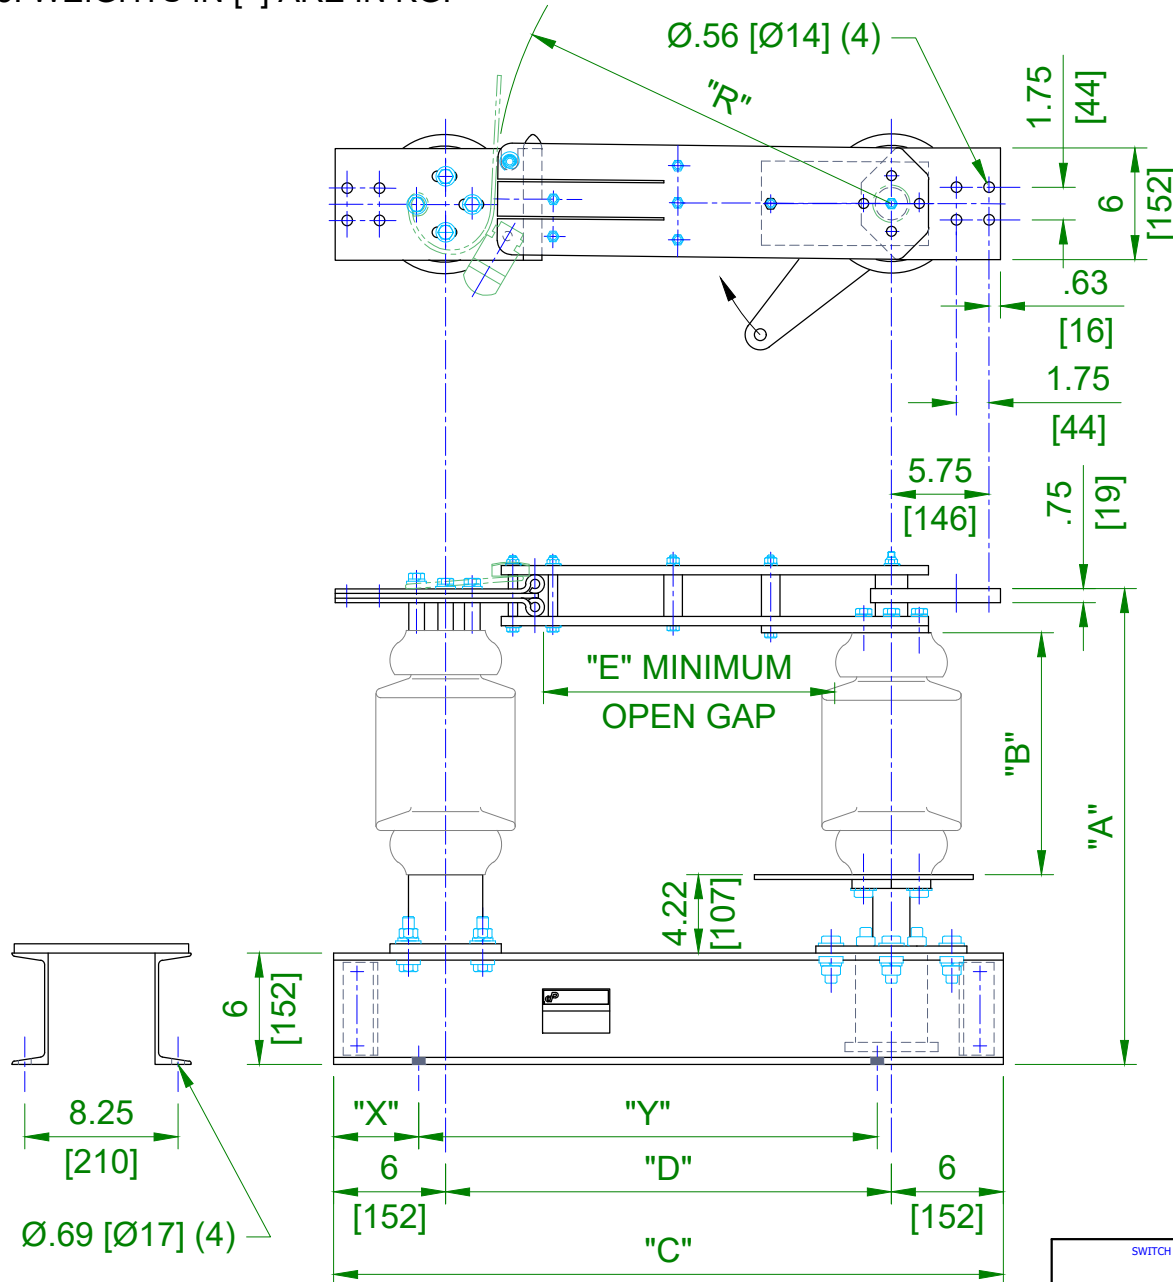

Cleaveland/Price Inc. 14000 Rt. 993 Trafford, PA 15085-9550

RL-C COPPER SIDE BREAK DISCONNECT SWITCH
7.2 - 34.5kV, 3000 AMP. WITH 3" B.C. INSULATORS

SWITCH STYLE REFERENCE NUMBER

-

REV

B

DRAWN

MD

DATE

06/10/2003

VERSION

2

CHECKED

LAB

APPROVED

DRAWING NO.

C04A582