


GROUP NO.	RATINGS					POST INSULATOR NEMA TR #	DIMENSIONS IN INCHES MILLIMETERS SHOWN IN []						WEIGHT/POLE (INCLUDING INSULATORS)	
	kV NOM.	kV MAX.	kV BIL	AMPS	kA MOM.		"A"	"A1"	"B"	"D"	"E"	"R"	lbs	kg
G01	14.4	15.5	110	600	40	205	13.88 [352]	14.25 [362]	10 [254]	20 [508]	10 [254]	22.06 [560]	139	[63]
G02				1200	61								151	[68.5]
G03				1600	70								159	[72.1]
G04				2000	70								163	[73.9]
G05	23	27	150	600	40	208	16.69 [424]	17.06 [433]	14 [356]	25.38 [645]	12 [305]	27.44 [697]	187	[84.8]
G06				1200	61								199	[90.3]
G07				1600	70								211	[95.7]
G08				2000	70								218	[98.9]
G09	34.5	38	200	600	40	210	19.63 [498]	20 [508]	18 [457]	31.31 [795]	18 [457]	33.38 [848]	240	[108.9]
G10				1200	61								253	[114.8]
G11				1600	70								267	[121.1]
G12				2000	70								277	[125.6]

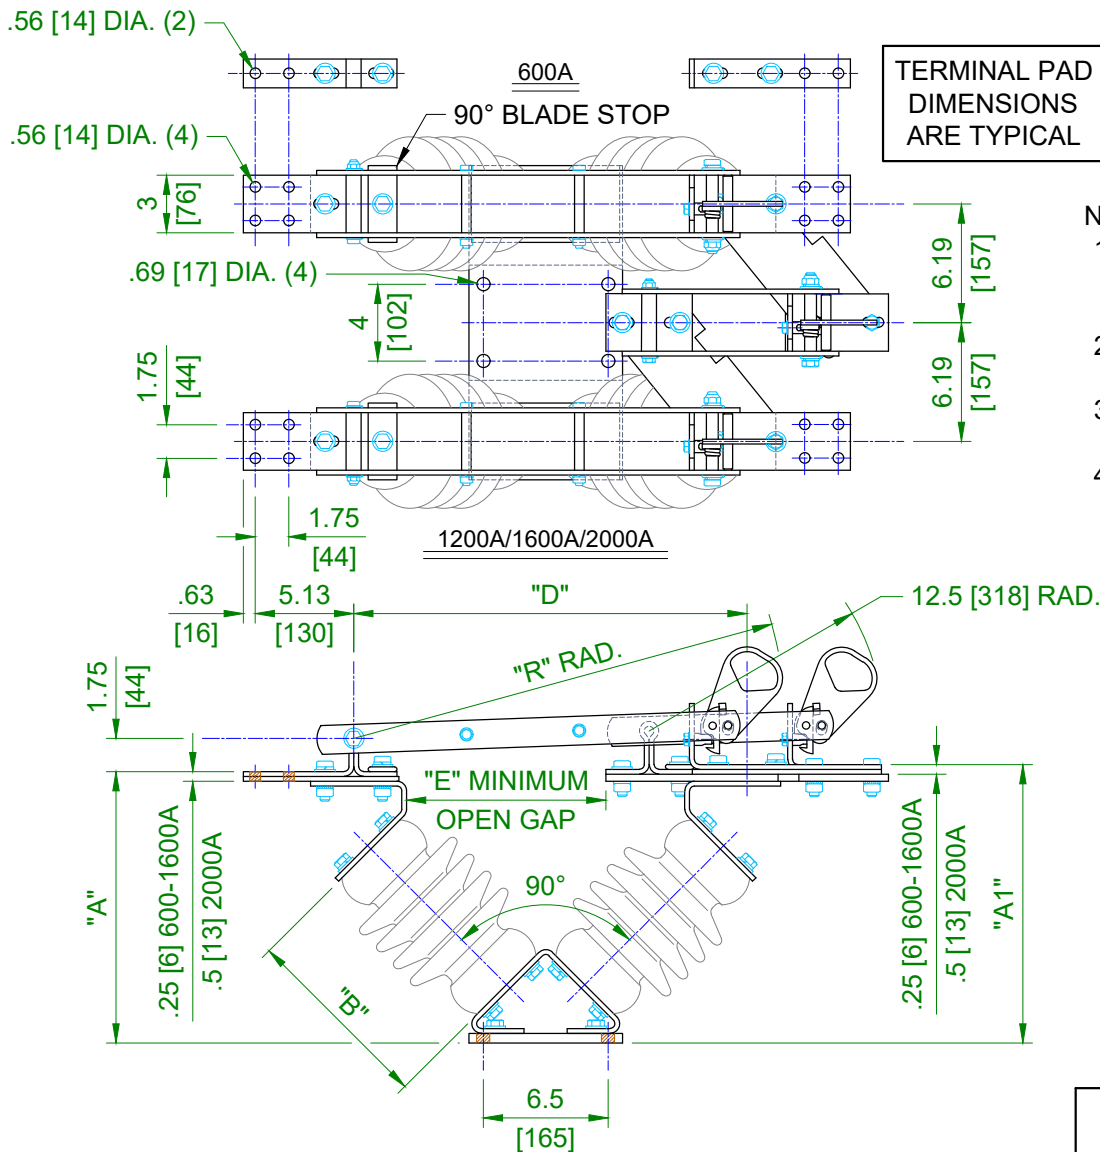

- NOTES:
1. INSULATORS INVERTED FOR UNDERHUNG MOUNTING.
 2. ALL DIMENSIONS ARE IN INCHES.
 3. DIMENSIONS SHOWN IN [] ARE IN MILLIMETERS.
 4. WEIGHTS SHOWN IN [] ARE IN KILOGRAMS.

REVISION

SWITCH STYLE REFERENCE NUMBER

REV

C

DRAWN
BRH

DATE
07/29/1998

VERSION
2

CHECKED
GH
APPROVED

DRAWING NO.

C13A300

Cleaveland/Price Inc. 14000 Rt. 993 Trafford, PA 15085-9550

RBI-V COPPER HOOKSTICK OPERATED BYPASS SWITCH
14.4kV-34.5kV; 600A-2000A; 3" B.C. INSULATORS